

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH BASED ON QUANTITIES IN DP CHARTS NOT TO EXCEED THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. **THROUGH FRAME:** FOR INSTALLATION INTO WOOD FRAMING USE #10 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2" MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
6. **THROUGH FRAME:** FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 1/4" DIAMETER ITW TAPCONS, ELCO ULTRACONS, ELCO CRETE-FLEX OR HILTI KWIK-CON II OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4" MINIMUM EMBEDMENT.
7. **THROUGH FRAME:** FOR INSTALLATION INTO METAL STUD OR APPROVED MULLION USE #10 GR. 5 SELF TAPPING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND METAL FRAME SUBSTRATE.
8. CLIPS SHALL BE FASTENED TO THE WINDOW FRAME WITH (2) #8 X 5/8" SCREWS. CLIPS ARE 20 GAUGE (0.063" THICKNESS) F<sub>y</sub>=33 KSI MIN STEEL WITH OVERALL DIMENSIONS OF 1.5" WIDE, 7.813" ALONG THE LONG LEG, AND 1.942" ALONG THE SHORT LEG.
9. **CLIP ANCHOR:** FOR INSTALLATION INTO WOOD FRAMING USE (2) #10 WOOD SCREWS PER CLIP OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2" MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
10. **CLIP ANCHOR:** FOR INSTALLATION INTO METAL STUD USE (2) #10 GR. 5 SELF-TAPPING SCREWS PER CLIP OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM PENETRATION BEYOND THE METAL STRUCTURE.
11. 1.5" X 1.5" X 0.060" 6063-T5 ALUMINUM NAIL FIN SHALL BE FASTENED TO THE WINDOW FRAME WITH #8 X 1/2" SCREWS, 12" MAX. ON CENTER AND 4" MAX. FROM CORNERS, AND 3M VHB TAPE.
12. **NAIL FIN:** FOR INSTALLATION INTO WOOD FRAMING USE #10 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2" MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
13. **NAIL FIN:** FOR INSTALLATION INTO METAL STUD OR APPROVED MULLION USE #10 GR. 5 SELF TAPPING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND METAL FRAME SUBSTRATE.
14. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
15. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
16. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
17. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

WINDSOR WINDOWS & DOORS

PINNACLE WOOD CLAD DOUBLE HUNG WINDOW

(IMPACT) (HVHZ)

CONTINUED INSTALLATION NOTES:

18. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
- A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
- B. CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
- C. GROUT-FILLED CMU- UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MINIMUM GROUT COMPRESSIVE STRENGTH OF 2000 PSI.
- D. HOLLOW BLOCK CMU - UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI.
- E. STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 18 GA. WALL THICKNESS.
- F. ALUMINUM - MINIMUM ALLOY 6063-T5. MINIMUM WALL THICKNESS OF 1/8" (0.125").

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
- TAS 201-94

TAS 202-94

TAS 203-94

ASTM E 1886-13A

ASTM E 1996-14A
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. WINDOW FRAME MATERIAL: WOOD  
WINDOW CLADDING MATERIAL: ALUMINUM 6063-T5
7. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 7 FOR GLAZING DETAILS.

TABLE OF CONTENTS		
SHEET	REVISION	SECTION DESCRIPTION
1	-	INSTALLATION AND GENERAL NOTES
2	-	ELEVATION AND ANCHOR LAYOUTS(UNEVEN SPLIT)
3	-	ELEVATION AND ANCHOR LAYOUTS(EQUAL SPLIT)
4	-	VERTICAL SECTIONS
5	-	VERTICAL SECTIONS
6	-	HORIZONTAL SECTIONS
7	-	HORIZONTAL SECTIONS, GLAZING DETAIL & MEETING RAIL DETAIL

DESIGN PRESSURE			
MAX. OVERALL SIZE		DESIGN PRESSURE	MISSILE IMPACT RATED
WIDTH	HEIGHT		
41.375"	88.750"	+50/-65 PSF	LARGE & SMALL MISSILE IMPACT RATED



WINDSOR WINDOWS & DOORS

900 S. 19TH STREET.  
WEST DES MOINES, IA 50265  
PH: (515)223-6660 FAX: (515)224-1938


TITLE: PINNACLE WOOD CLAD DH WINDOW (IMPACT) (HVHZ)

INSTALLATION AND GENERAL NOTES

PREPARED BY: BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

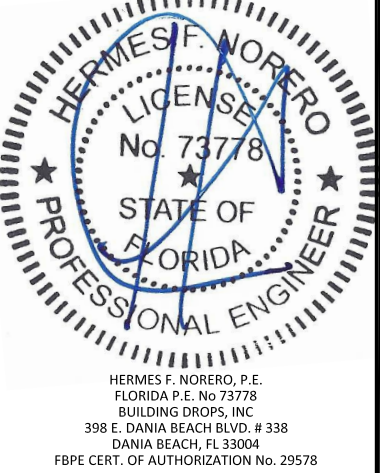

FL 11092

DATE: 02.12.20

DWG. BY: RV

CHK. BY: HFN

SCALE: NTS

DWG. #: WWD052

SHEET: 1 OF 7



WINDSOR WINDOWS  
& DOORS  
900 S. 19TH STREET.  
WEST DES MOINES, IA 50265  
PH: (515)223-6660 FAX: (515)224-1938

TITLE: PINNACLE WOOD CLAD DH  
WINDOW (IMPACT) (HVHZ)  
ELEVATION & ANCHOR  
LAYOUTS ( UNEVEN SPLIT)

PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC  
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC  
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE  
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED  
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC  
DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.  
FLORIDA P.E. No 73778  
BUILDING DROPS, INC  
398 E. DANIA BEACH BLVD. # 338  
DANIA BEACH, FL 33004  
FBPE CERT. OF AUTHORIZATION No. 29578

FL 11092

DATE: 02.12.20

DWG. BY:  
RV

CHK. BY:  
HFN


SCALE: NTS

DWG. #: WWD052


SHEET:

2


OF 7

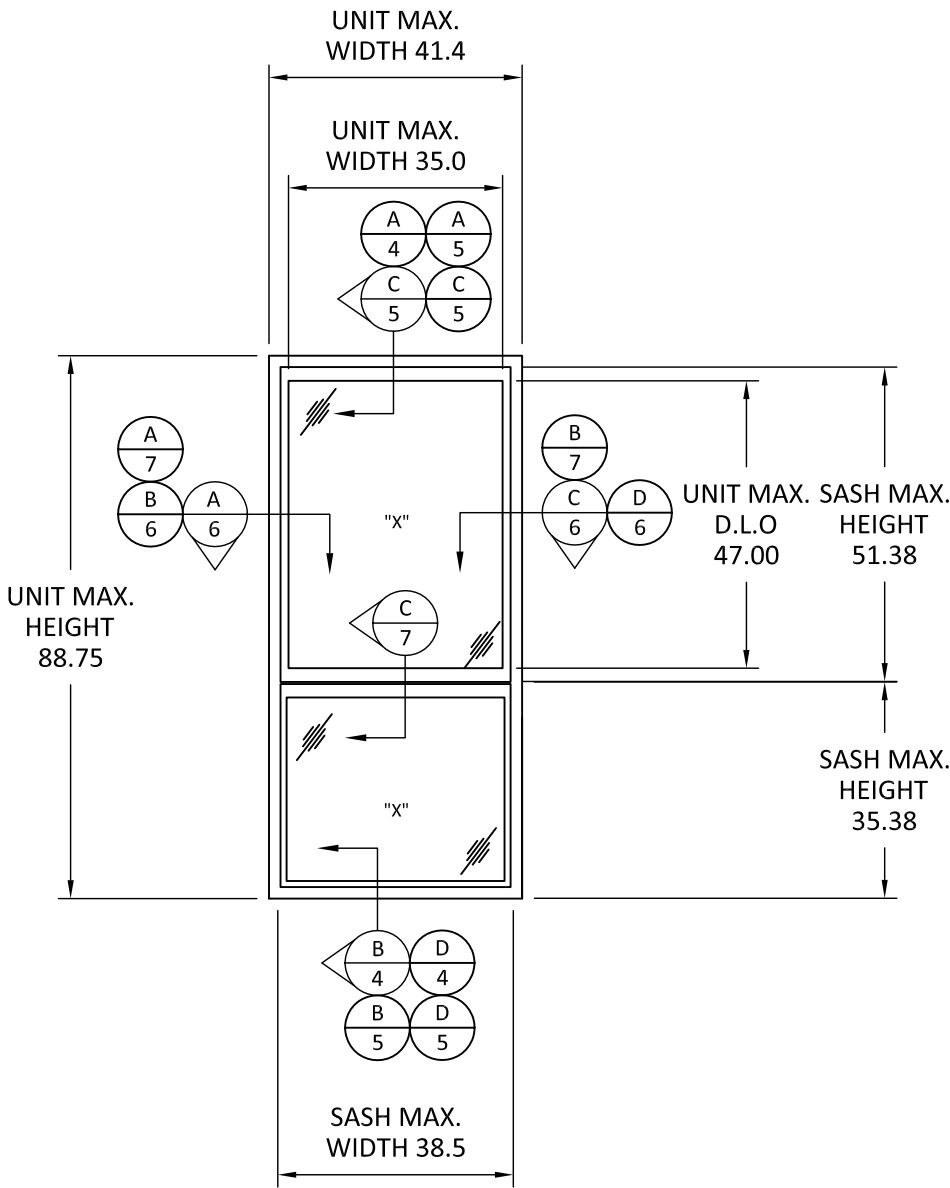

**TYPICAL ELEVATION**  
DOUBLE HUNG

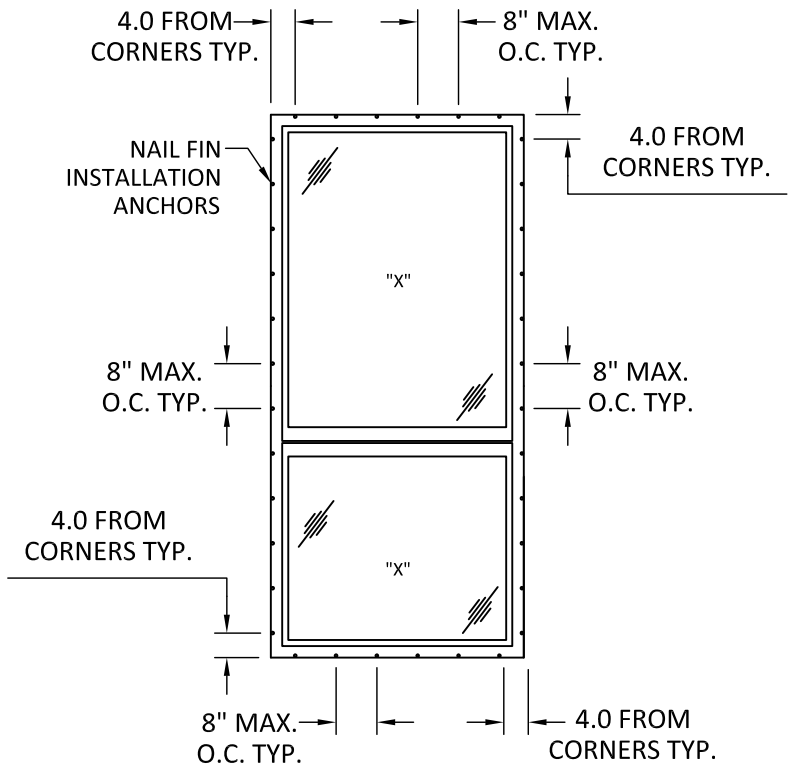

**ANCHOR LAYOUT**  
NAIL FIN INSTALLATION

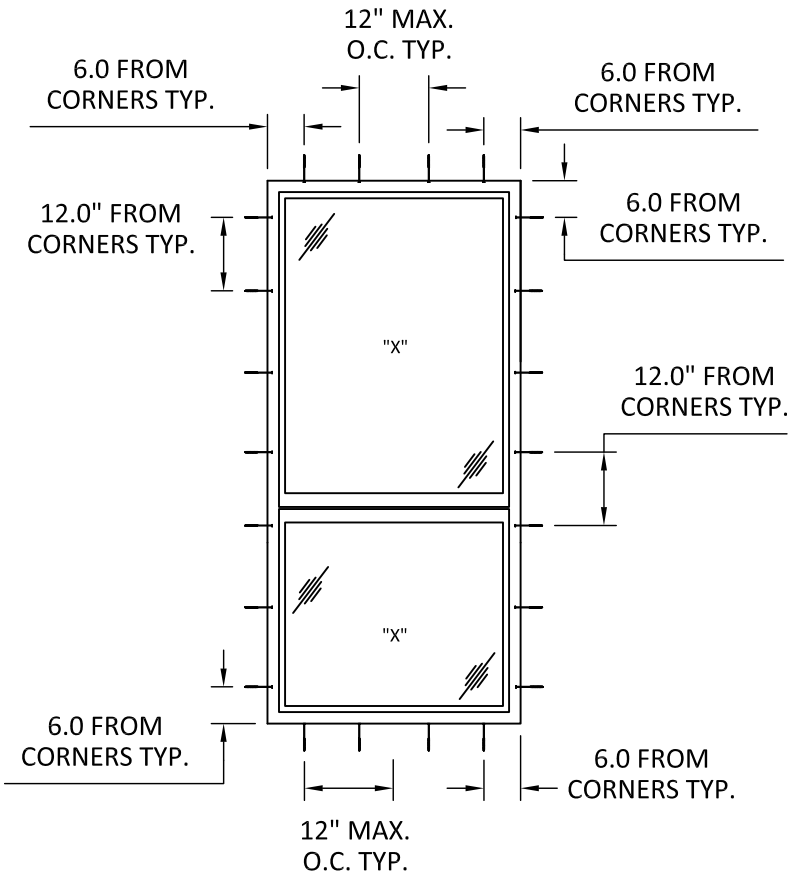

**ANCHOR LAYOUT**  
CLIP OR THRU-FRAME INSTALLATION



WINDSOR WINDOWS  
& DOORS  
900 S. 19TH STREET.  
WEST DES MOINES, IA 50265  
PH: (515)223-6660 FAX: (515)224-1938


TITLE: PINNACLE WOOD CLAD DH  
WINDOW (IMPACT) (HVHZ)  
ELEVATION & ANCHOR  
LAYOUTS (EQUAL SPLIT)

PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC  
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC  
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE  
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED  
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC  
DOCUMENTS FOR USE WITH THIS DOCUMENT.

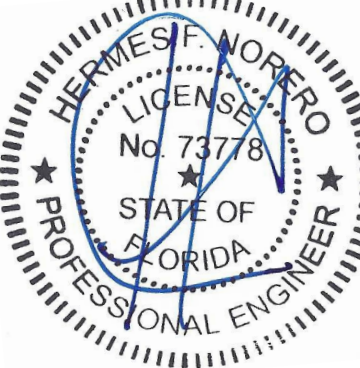

HERMES F. NORERO, P.E.  
FLORIDA P.E. No 73778  
BUILDING DROPS, INC  
398 E. DANIA BEACH BLVD. # 338  
DANIA BEACH, FL 33004  
FBPE CERT. OF AUTHORIZATION No. 29578

FL 11092

DATE: 02.12.20

DWG. BY:  
RV

CHK. BY:  
HFN


SCALE: NTS

DWG. #: WWD052


SHEET:

3


OF 7

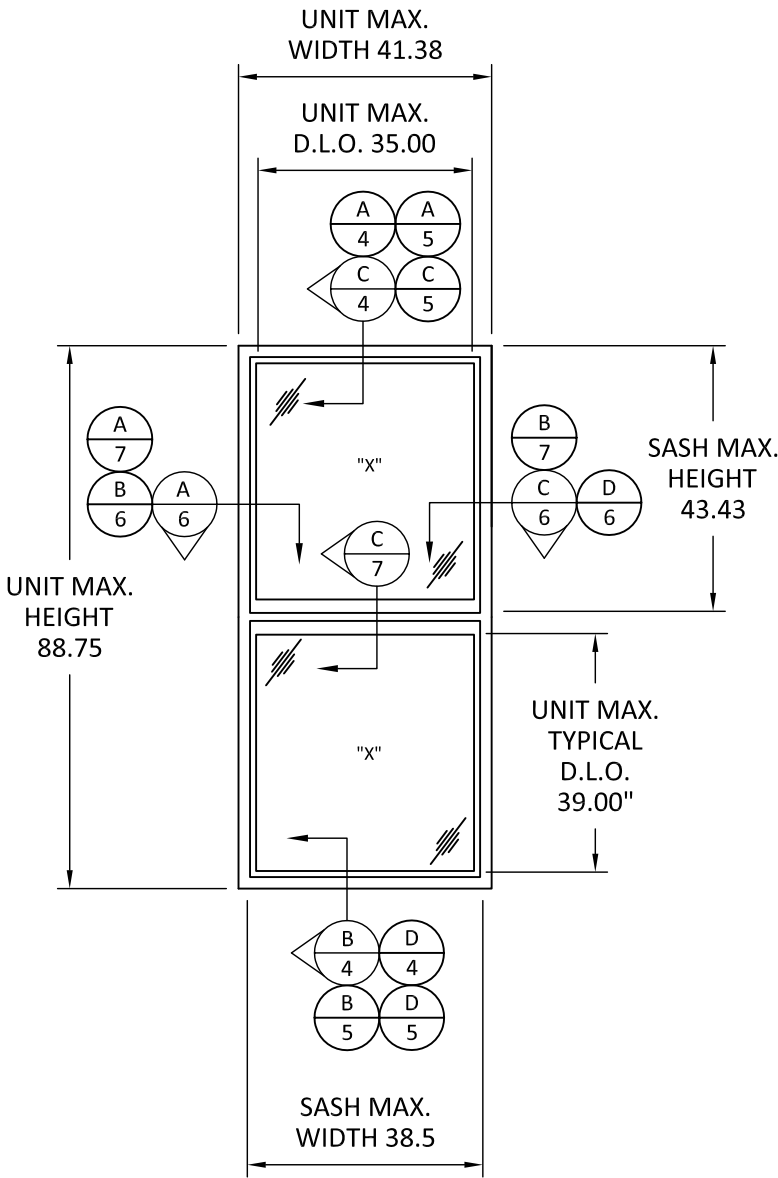

**TYPICAL ELEVATION**  
DOUBLE HUNG

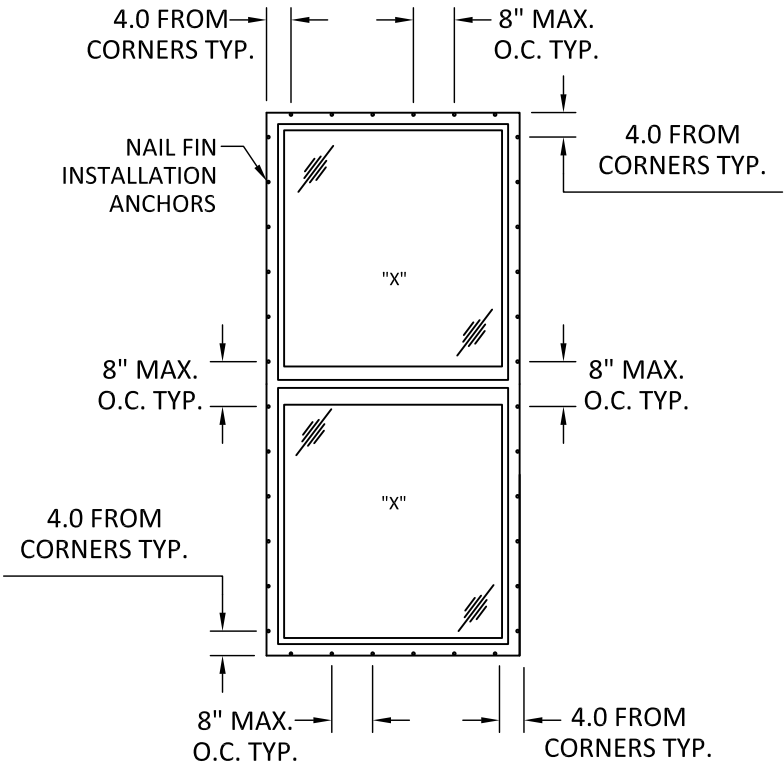


**ANCHOR LAYOUT**  
NAIL FIN INSTALLATION

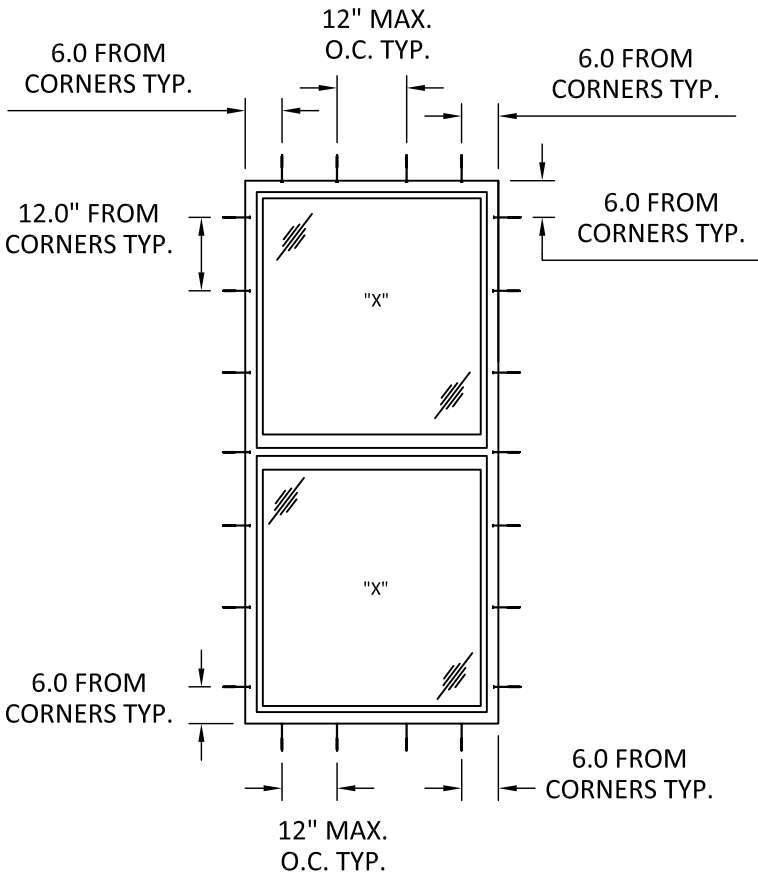


**ANCHOR LAYOUT**  
CLIP OR THRU-FRAME INSTALLATION



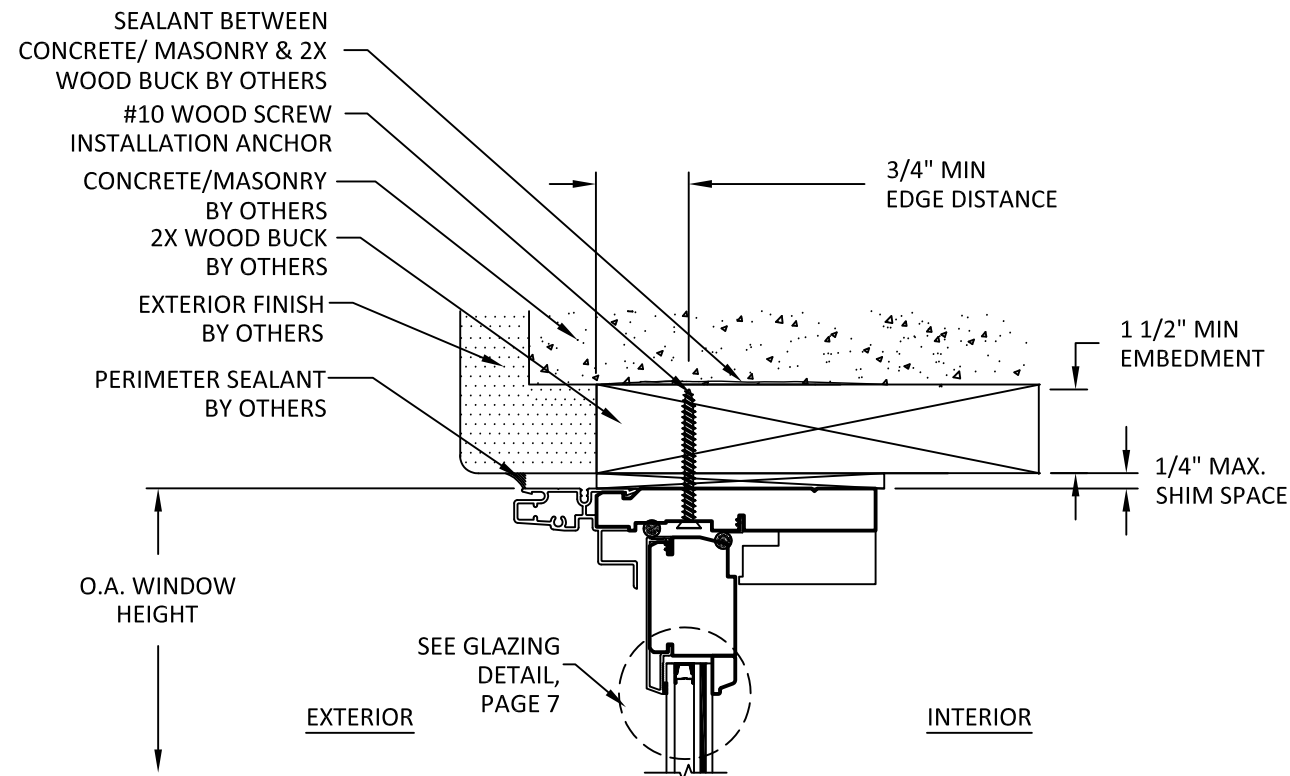


**A**  
**4** **VERTICAL SECTION**  
DH HEAD - 2X WOOD BUCK  
THROUGH FRAME INSTALLATION

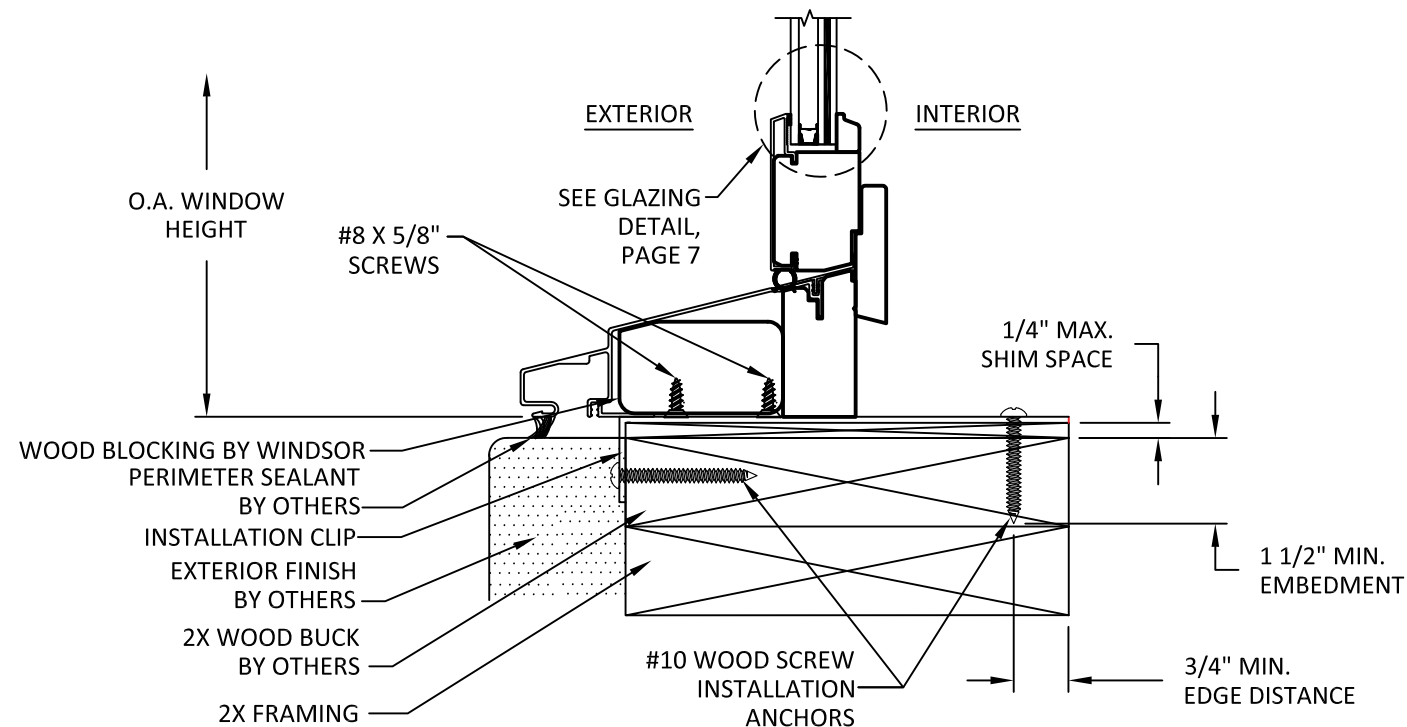


NOTE:  
INSTALLATION AT SILL SHALL USE  
CLIPS. THROUGH FRAME  
INSTALLATION NOT PERMITTED.

**B**  
**4** **VERTICAL SECTION**  
DH SILL - WOOD FRAMING  
CLIP INSTALLATION

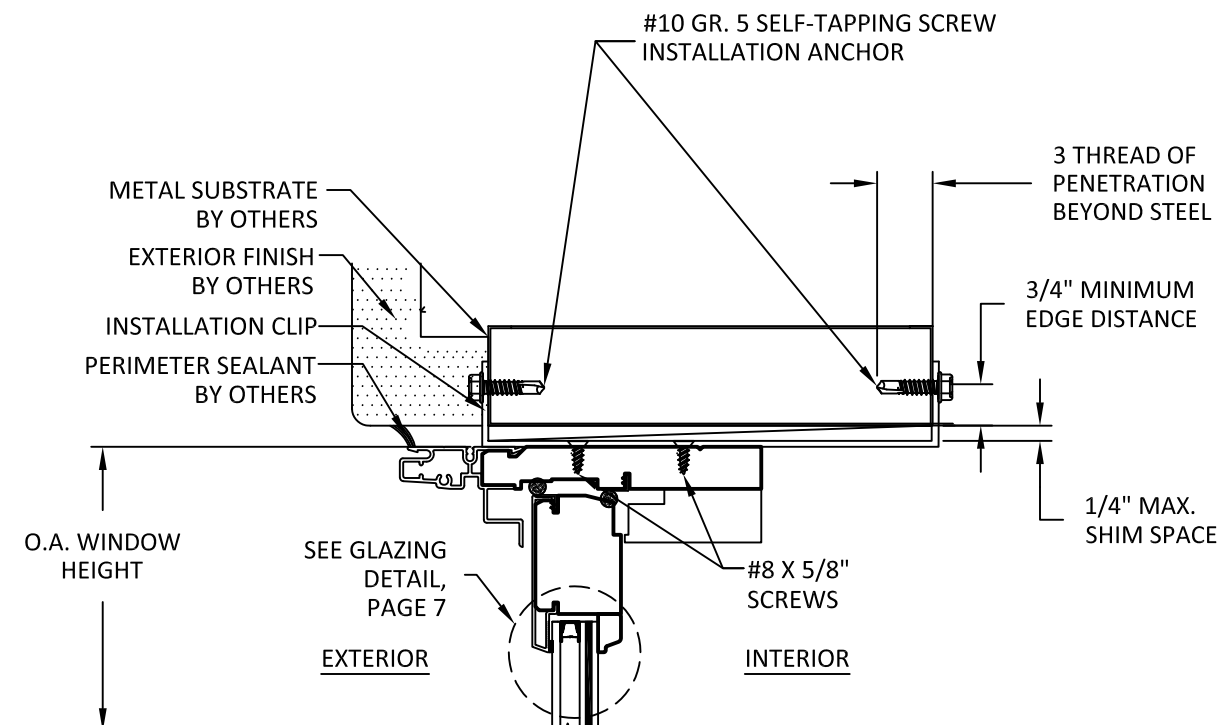

**C**  
**4** **VERTICAL SECTION**  
DH HEAD - METAL SUBSTRATE  
STANDARD CLIP INSTALLATION

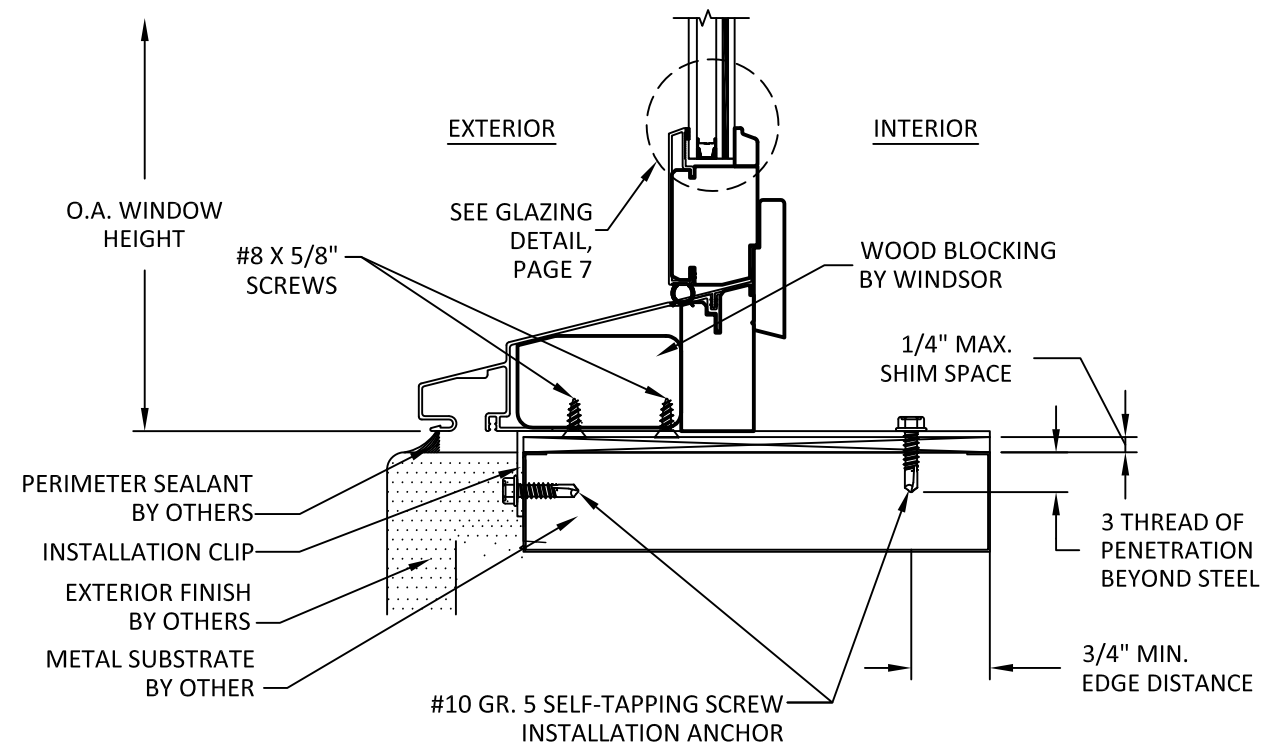

**D**  
**4** **VERTICAL SECTION**  
DH SILL - METAL SUBSTRATE  
ALTERNATE CLIP INSTALLATION



**WINDSOR WINDOWS  
& DOORS**

900 S. 19TH STREET.  
WEST DES MOINES, IA 50265  
PH: (515)223-6660 FAX: (515)224-1938

TITLE: PINNACLE WOOD CLAD DH  
WINDOW (IMPACT) (HVHZ)

VERTICAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC  
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC  
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE  
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED  
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC  
DOCUMENTS FOR USE WITH THIS DOCUMENT.

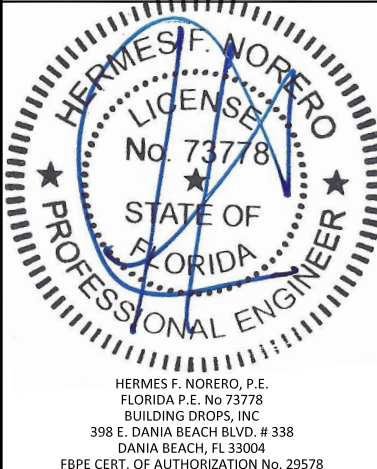

**FL 11092**

DATE: 02.12.20

DWG. BY: RV CHK. BY: HFN

SCALE: NTS

DWG. #: WWD052

SHEET:

4

OF 7

TITLE: PINNACLE WOOD CLAD DH  
WINDOW (IMPACT) (HVHZ)

VERTICAL SECTIONS

PREPARED BY:  
**BUILDING DROPS, INC.**

398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC  
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC  
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE  
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED  
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC  
DOCUMENTS FOR USE WITH THIS DOCUMENT.




**FL 11092**


DATE:	02.12.20
DWG. BY:	RV
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WWD052
SHEET:	5

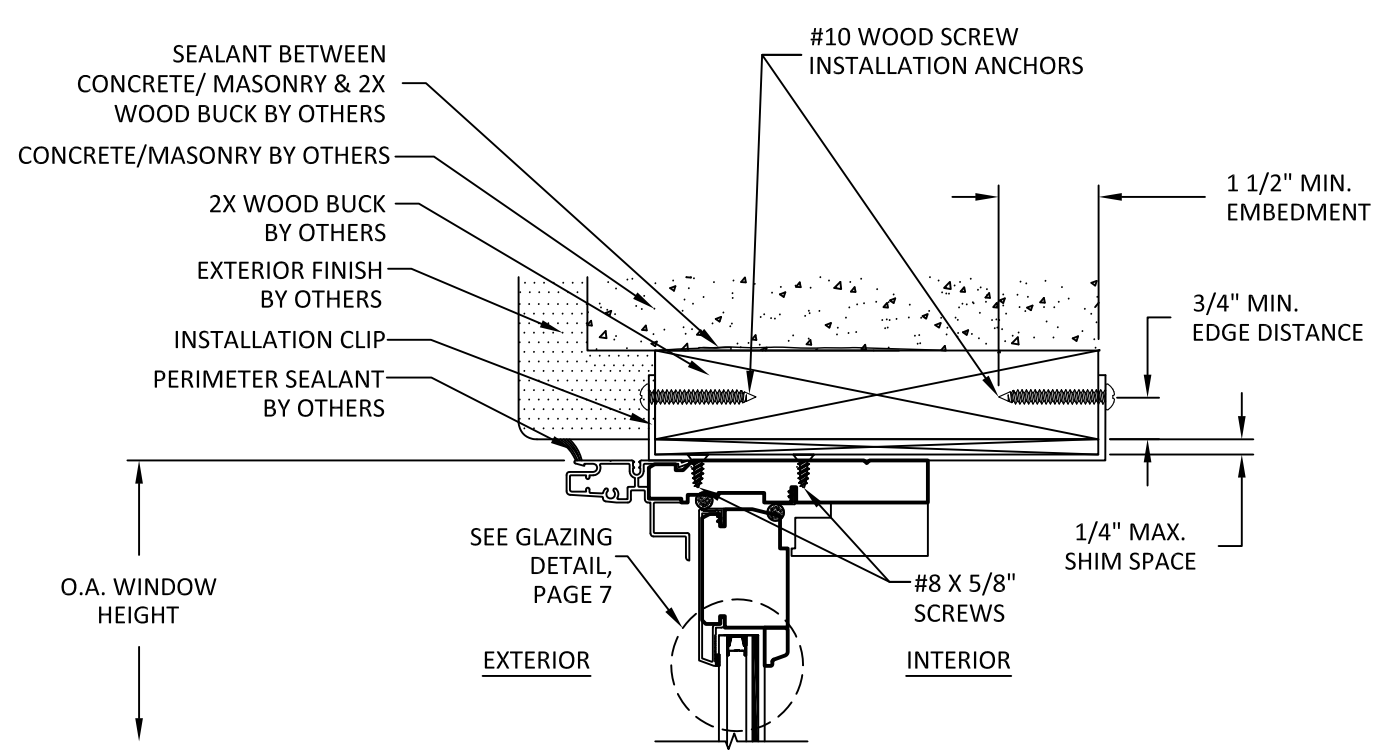


**A**  
**5**  
**VERTICAL SECTION**  
DH HEAD - 2X WOOD BUCK  
STANDARD CLIP INSTALLATION

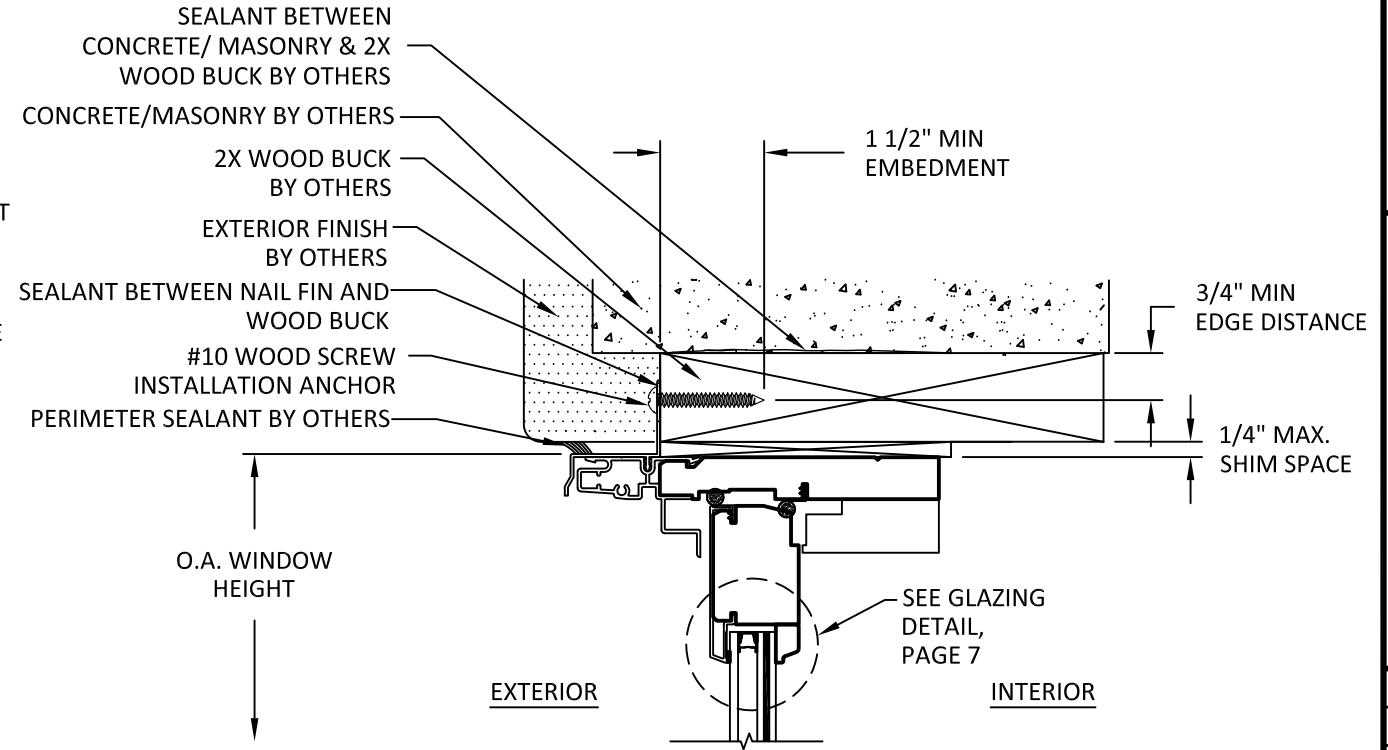


**C**  
**5**  
**VERTICAL SECTION**  
DH HEAD - 2X WOOD BUCK  
NAIL FIN INSTALLATION

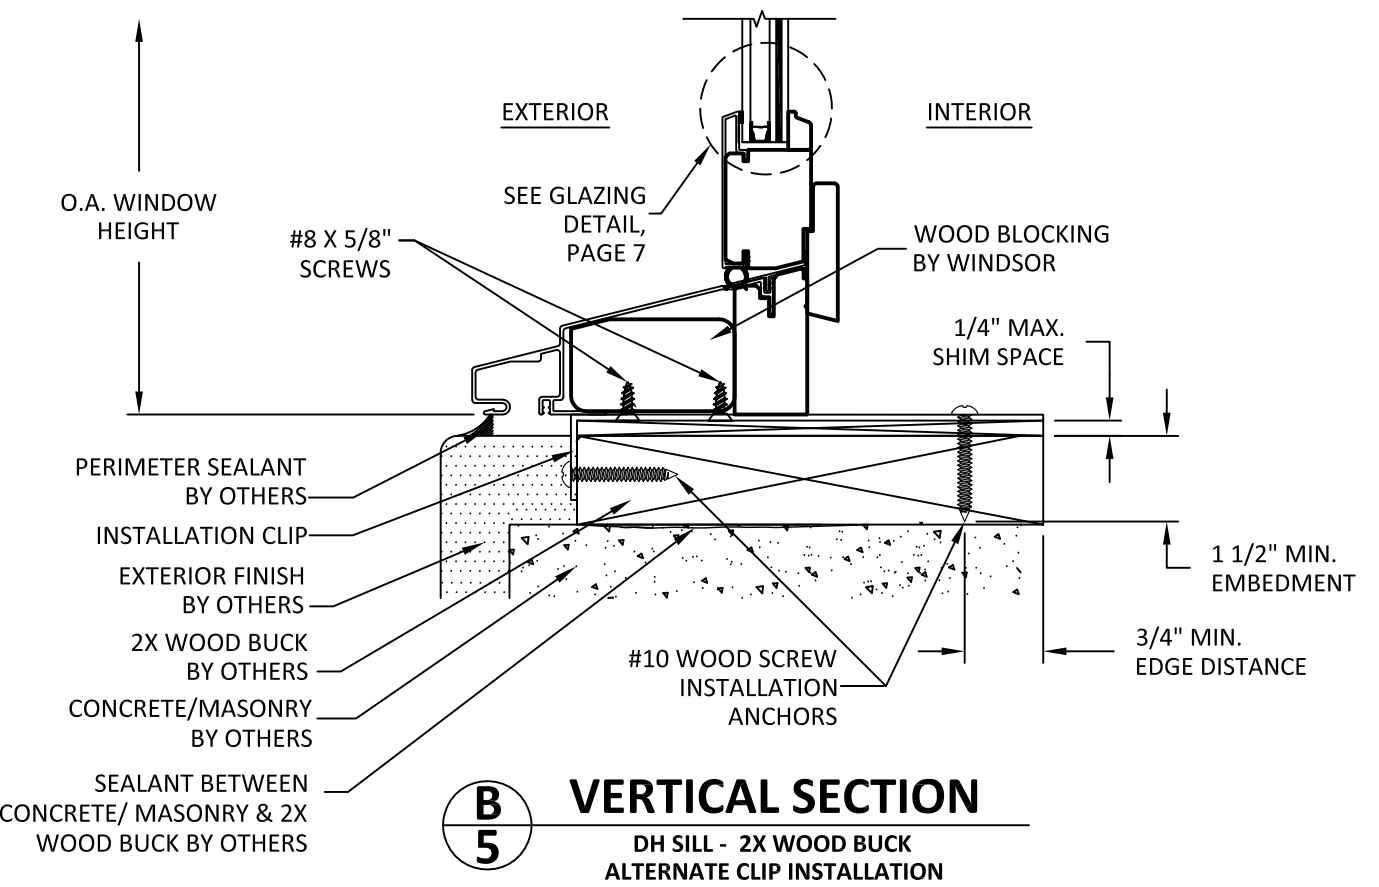


**B**  
**5**  
**VERTICAL SECTION**  
DH SILL - 2X WOOD BUCK  
ALTERNATE CLIP INSTALLATION

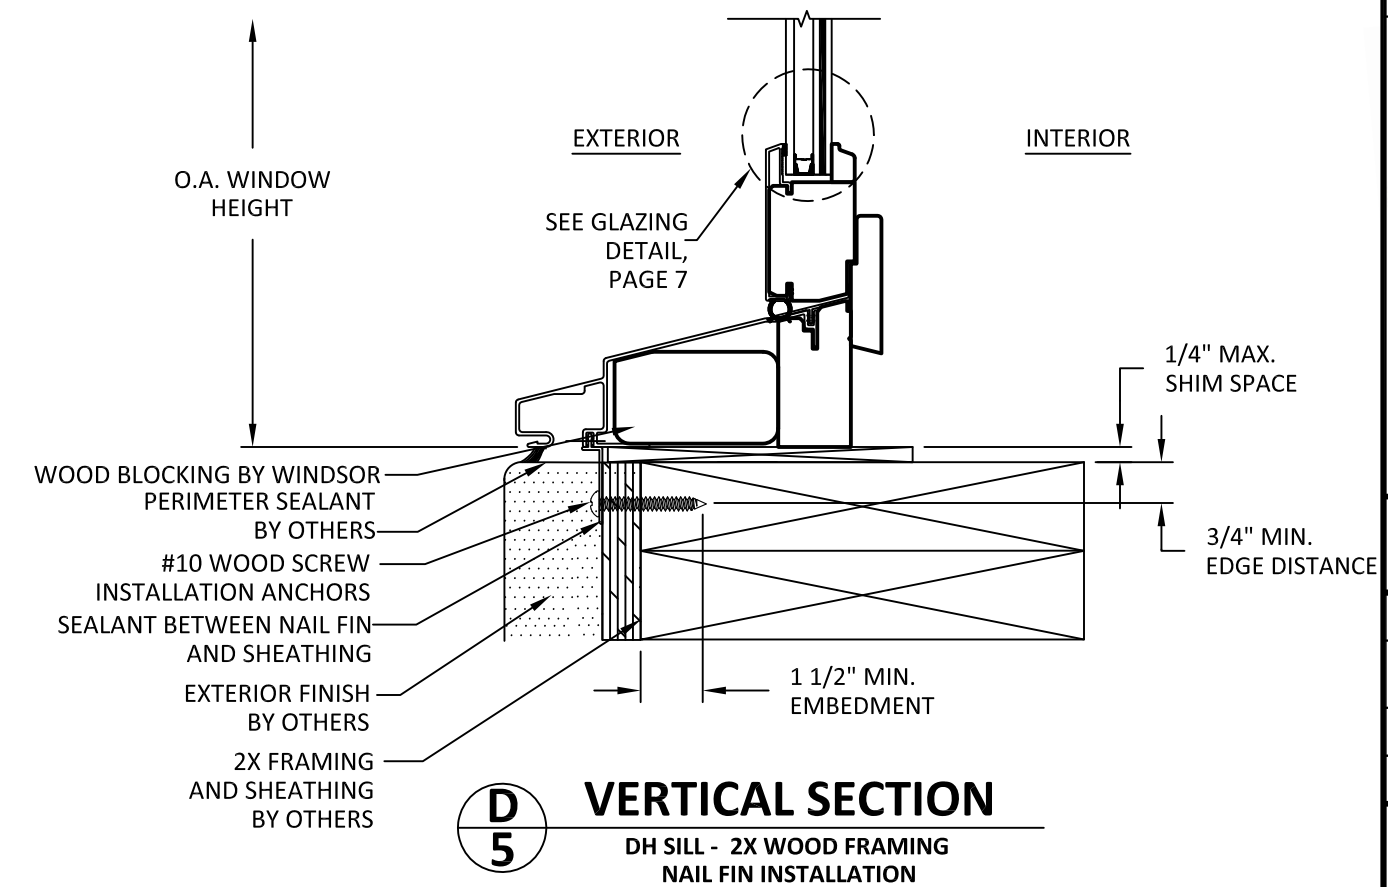


**D**  
**5**  
**VERTICAL SECTION**  
DH SILL - 2X WOOD FRAMING  
NAIL FIN INSTALLATION

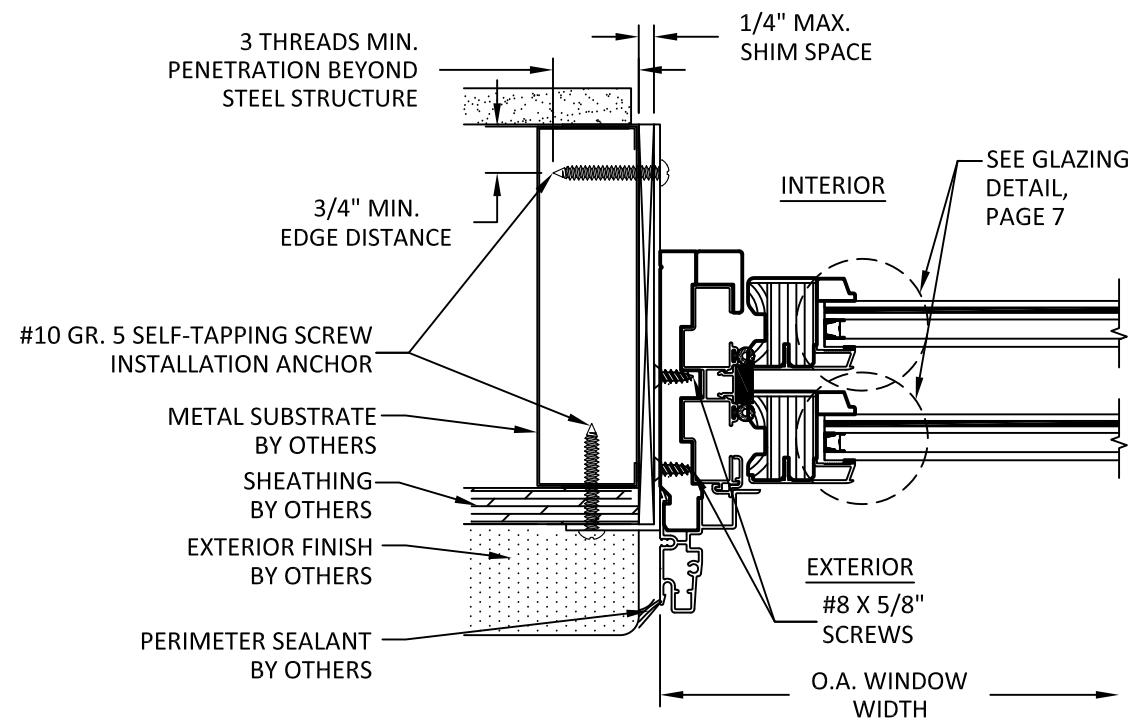


**A**  
**6** **HORIZONTAL SECTION**  
DH JAMB - STEEL STUD FRAME  
ALTERNATE CLIP INSTALLATION

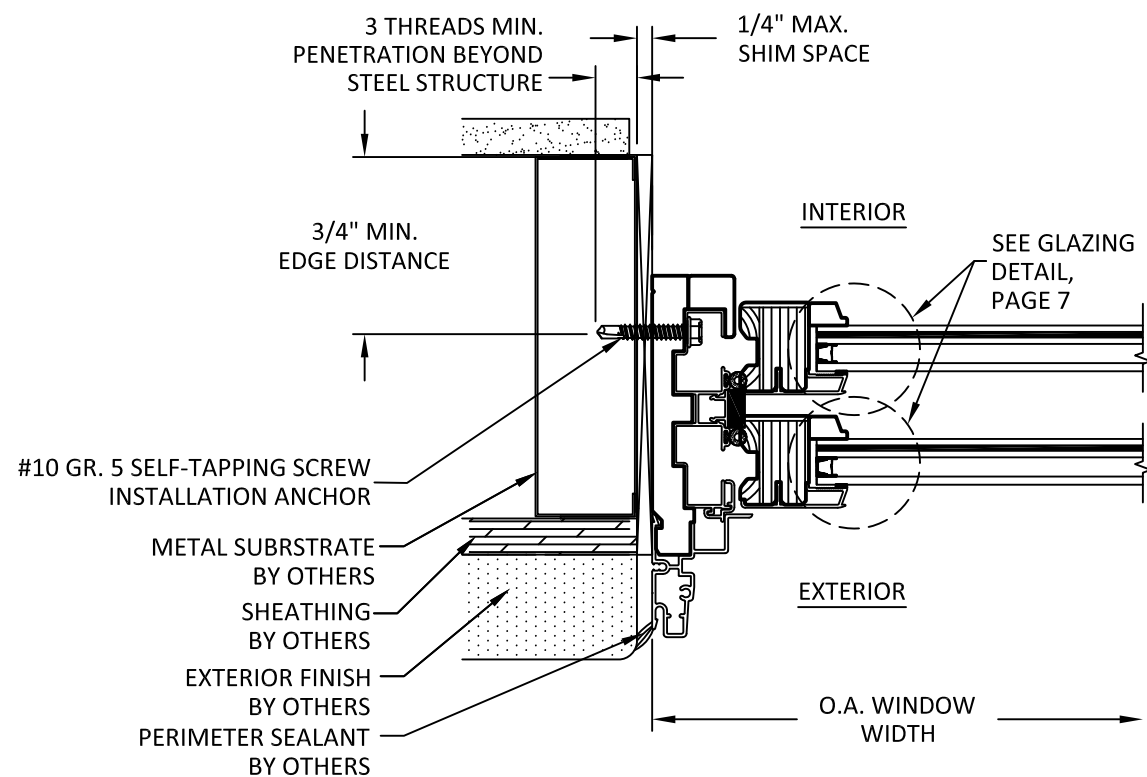

**B**  
**6** **HORIZONTAL SECTION**  
DH JAMB - STEEL STUD FRAME  
THROUGH FRAME INSTALLATION

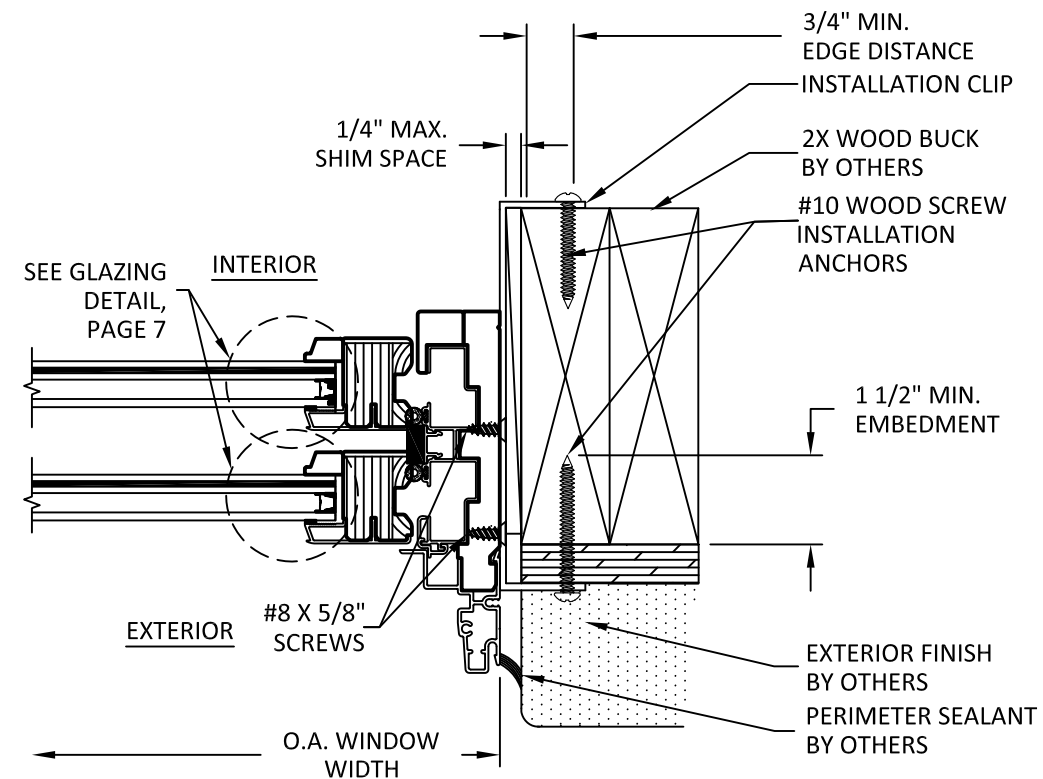

**C**  
**6** **HORIZONTAL SECTION**  
DH JAMB - 2X WOOD FRAMING  
STANDARD CLIP INSTALLATION

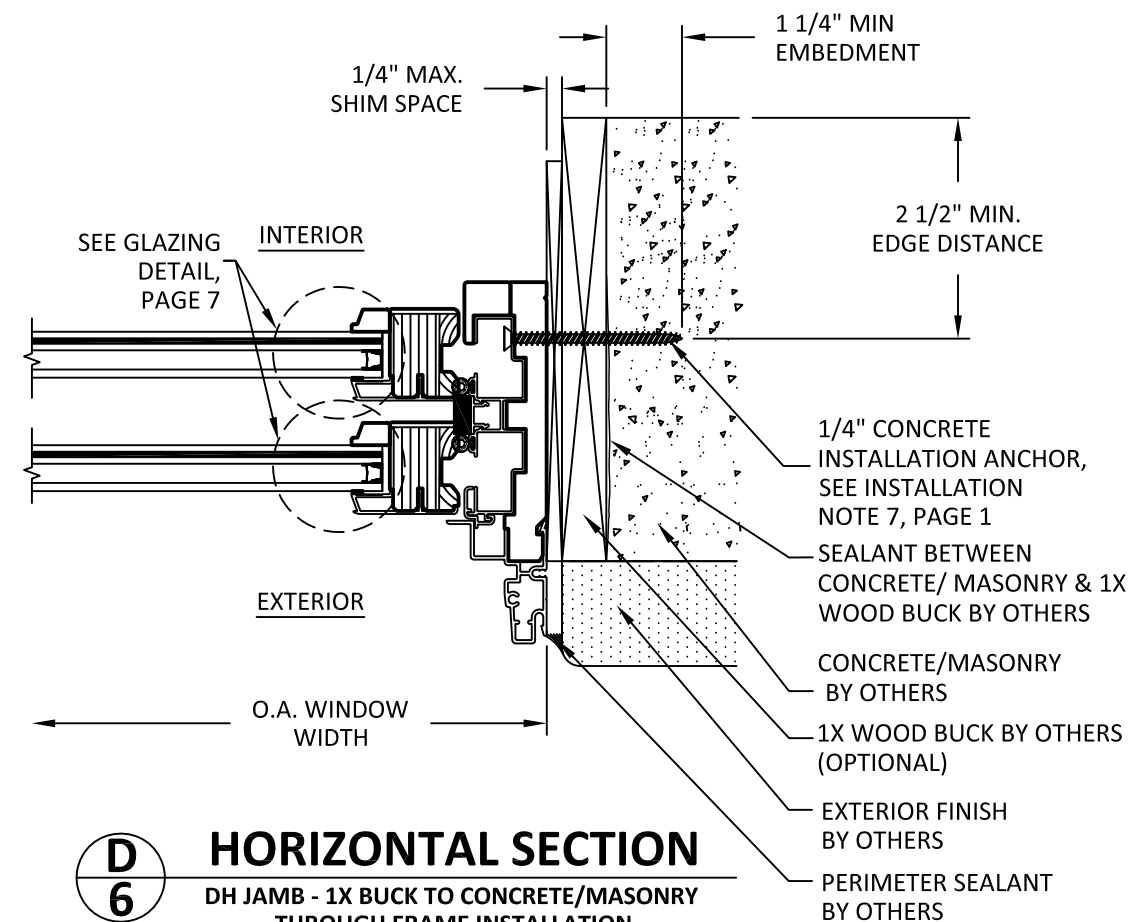

**D**  
**6** **HORIZONTAL SECTION**  
DH JAMB - 1X BUCK TO CONCRETE/MASONRY  
THROUGH FRAME INSTALLATION



**WINDSOR WINDOWS & DOORS**  
900 S. 19TH STREET.  
WEST DES MOINES, IA 50265  
PH: (515)223-6660 FAX: (515)224-1938

TITLE: PINNACLE WOOD CLAD DH WINDOW (IMPACT) (HVHZ)

HORIZONTAL SECTION


PREPARED BY: BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

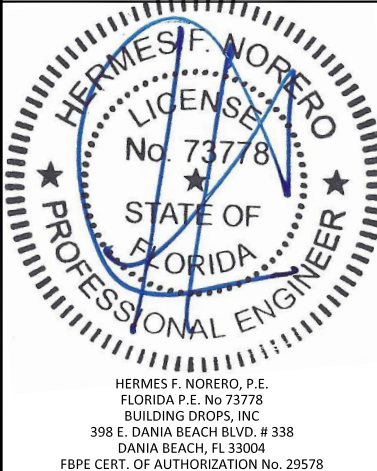

**FL 11092**

DATE: 02.12.20

DWG. BY: RV CHK. BY: HFN

SCALE: NTS

DWG. #: WWD052

SHEET:

6


OF 7



TITLE: PINNACLE WOOD CLAD DH WINDOW (IMPACT) (HVHZ)  
HORIZONTAL SECTIONS, GLAZING DETAIL & MEETING RAIL DETAIL  
PREPARED BY: BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

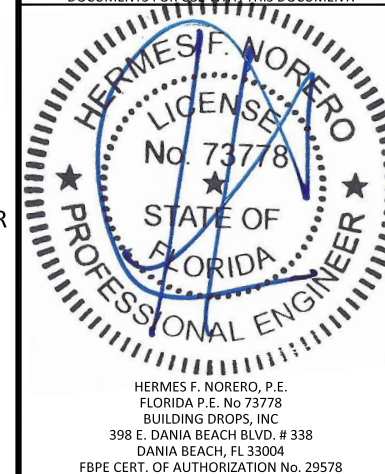

**FL 11092**

DATE: 02.12.20

DWG. BY: RV

CHK. BY: HFN


SCALE: NTS

DWG. #: WWD052


SHEET:

7

OF 7

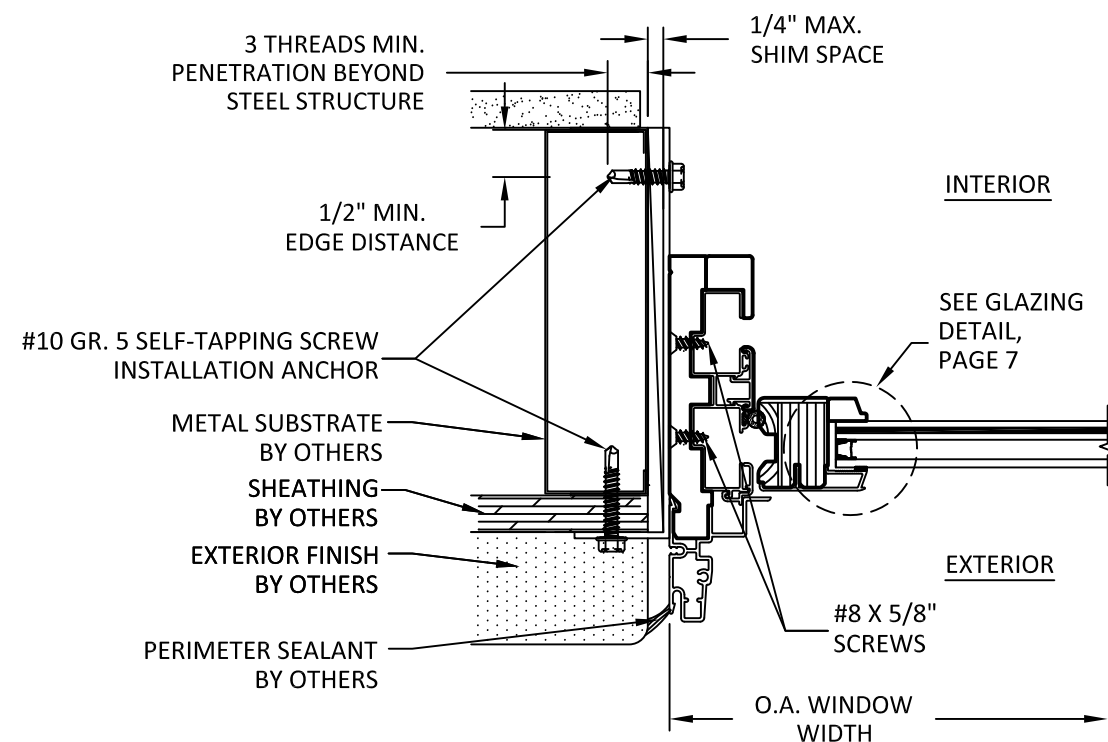

**A**  
**7**  
**HORIZONTAL SECTION**  
DH LOWER DETAIL - METAL STUD FRAME  
ALTERNATE CLIP INSTALLATION

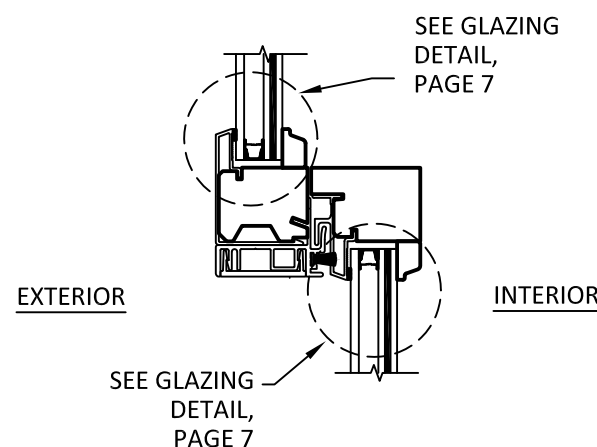


**C**  
**7**  
**VERTICAL SECTION**  
MEETING RAIL


GLAZING NOTES:  
GLASS THICKNESS AND TYPE COMPLIES WITH ASTM E1300 GLASS STRENGTH REQUIREMENTS.

ALL GLAZING CONFIGURATIONS COMPLIES WITH SAFETY GLAZING REQUIREMENTS OUTLINED IN CURRENT FBC.

\*ONLY TEMPERED GLASS ALLOW ON SACRIFICIAL LITE ON APPLICATIONS OVER 30 FT HEIGHT.

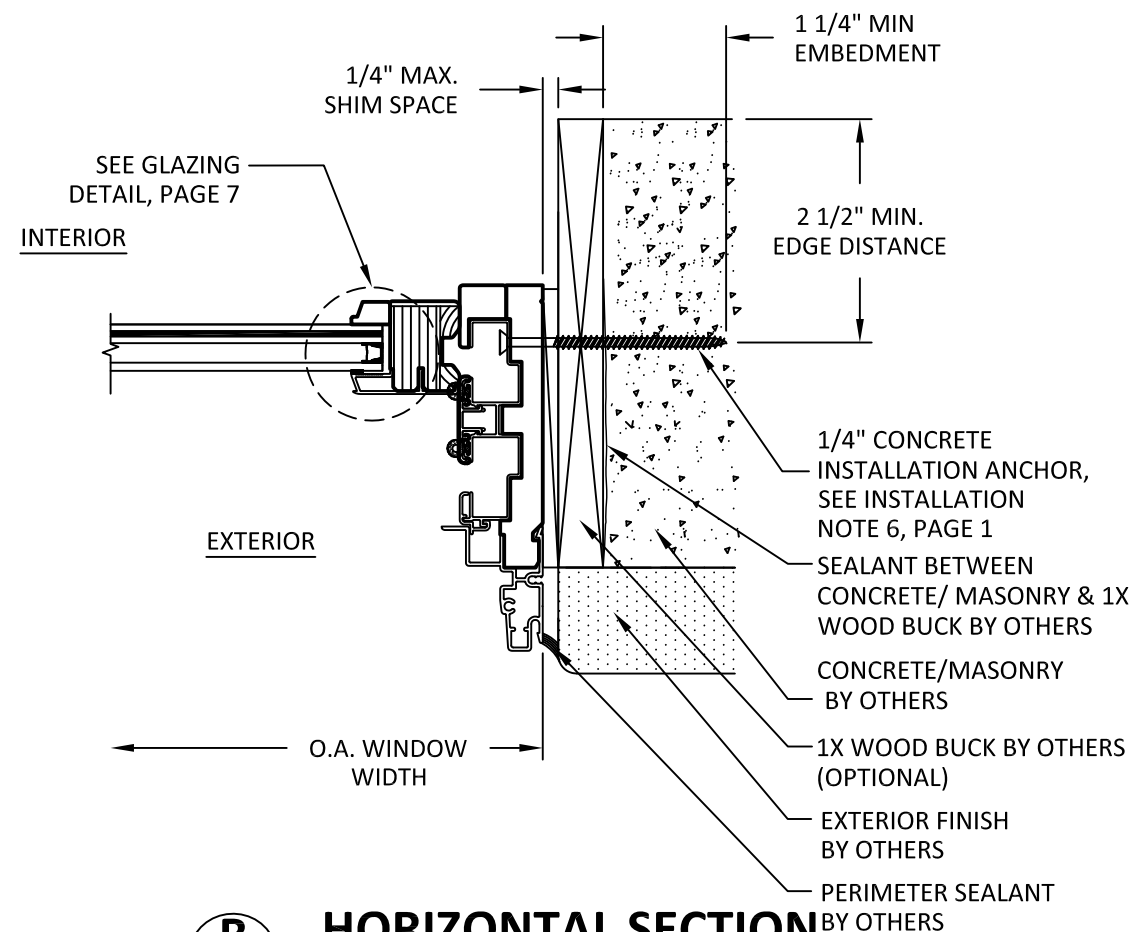

**B**  
**7**  
**HORIZONTAL SECTION**  
DH UPPER DETAIL - BUCK TO CONCRETE/MASONRY  
THROUGH FRAME INSTALLATION

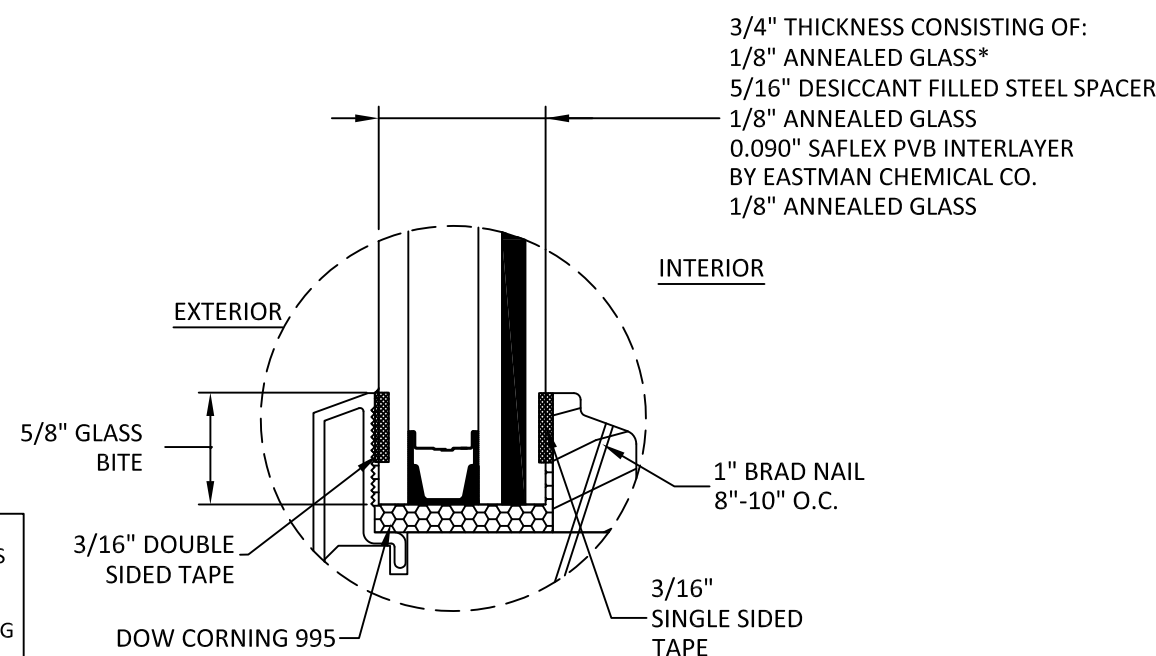

**GLAZING DETAIL**