

# NEXT DIMENSION PRO SERIES

## VERTICAL MULL REINFORCEMENT GUIDELINES

### Uni-Frame Construction with T-BAR

NOTE: SIZES SHOWN ARE FOR INDIVIDUAL UNIT SIZES WITHIN THE MULLED CONFIGURATION


	WINDOW WIDTH [IN]											
	18	24	30	36	42	48	54	60	66	72	78	84
18	50	50	50	50	50	50	50	50	50	50	50	50
24	50	50	50	50	50	50	50	50	50	50	50	50
30	50	50	50	50	50	50	50	50	50	50	50	50
36	50	50	50	50	50	50	50	50	50	50	50	50
42	50	50	50	50	50	50	50	50	50	50	50	50
48	50	50	50	50	50	50	50	50	50	50	50	50
54	50	50	50	50	50	50	50	50	50	50	50	50
60	50	50	50	50	50	50	50	50	50	50	50	50
66	50	50	50	50	50	50	50	50	50	50	45	40
72	50	50	50	50	50	50	50	50	45	40	40	35
78	50	50	50	50	50	50	50	40	40	35	30	30
84	50	50	50	50	50	45	40	35	35	30	30	25

- No Reinforcement
- Reinforcement Required
- Exceeds Mulling Limitations

Numbers shown are calculated **STRUCTURAL DP Rating for the mull ONLY**

Refer to individual unit ratings for structural, air and water performance of the individual unit(s).

For composite structural rating use the LOWER of the mull and unit(s) individual structural ratings.

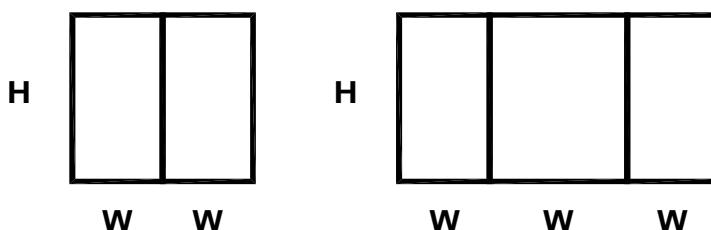

- Notes:
- 1) Use Largest Width (W)
  - 2) Maximum Deflection: Span / 30
  - 3) Rebar Specs: Aluminum I-Beam
  - 4) Overall Mulling Configuration not to Exceed: 108" x 84"